



# JACKSON BUREAU OF FIRE SAFETY

## FIRE DISTRICT NO. 1 & 3

200 KIERYCH MEMORIAL DRIVE  
JACKSON N.J. 08527

Phone (732) 928-1666x14 Fax (732) 928-6500  
[fmcdonnell@jacksonfiredist3.org](mailto:fmcdonnell@jacksonfiredist3.org) [www.jacksonfiredist3.org](http://www.jacksonfiredist3.org)




FRANK McDONNELL  
FIRE OFFICIAL

### REQUIREMENT FOR "FIRE LANES"

Jackson Township FIRE Code Chapter 61-7 E

Fire lane ground marking shall be a **minimum of 20' twenty feet** wide labeled "NO PARKING FIRE LANE" bordered by a (4) four inch wide yellow stripe on both sides with approved New Jersey Department of Transportation standard traffic yellow paint. The wording shall face direction of travel or alternate direction of travel for a maximum distance of every 100' feet on paved surface or as ordered by the Fire Official. The lettering shall be legible and the letter size shall be a minimum of twenty-four inches high and four-inch stroke.

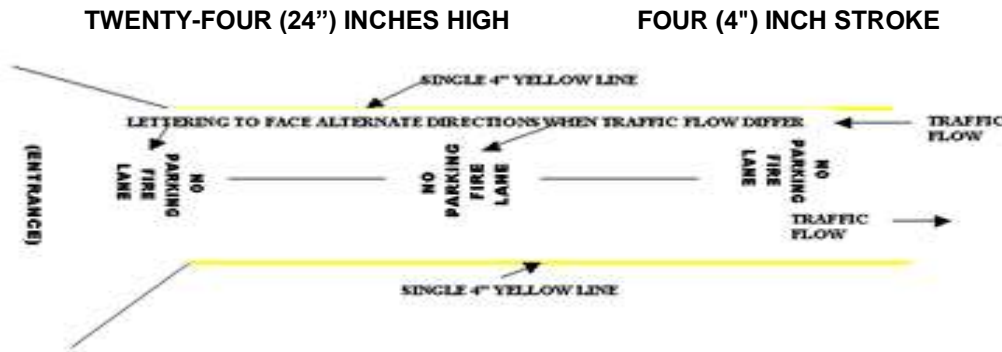


### "FIRE LANE SIGNS"

Fire lane signs shall be erected with the bottom of the sign not less than six feet above the ground, (12") twelve inches wide by (18") eighteen inches in length with a white reflective aluminum background with a red border and a minimum of (3") three inch sized reflective red letters labeled "NO" on the first line, (3") three inch sized reflective red letters labeled "PARKING" on the second line, (2") two inch sized reflective red letters labeled "FIRE" on the third line and (2") two inch sized reflective red letters labeled "LANE" or "ZONE" on the fourth line. Spacing of the signs shall be even, with one sign facing the direction of travel or alternate direction of travel for a maximum distance 100' one hundred feet per sign or as ordered by the Fire Official.



## REQUIREMENTS FOR "FIRE ZONES"

Fire zone ground marking shall be a minimum of (12') twelve feet wide and (10') ten feet in length posted with a fire zone sign and ground marking labeled "FIRE ZONE" bordered by a 4" four inch wide yellow stripe and diagonal stripes with approved New Jersey Department of Transportation standard traffic yellow paint lettered legible on a paved surface. The lettering shall be a minimum of twenty-four inches high and four-inch stroke. Two crash posts shall be installed if required by the Fire Official and constructed of steel not less than 4 inches in diameter and concrete filled painted yellow. The posts shall be spaced not more than 4 feet 6 inches between posts on center, set not less than 3 feet 6 inches deep in a concrete footing of not less than an 18-inch diameter. The top of the posts shall not be less than 3 feet above ground.

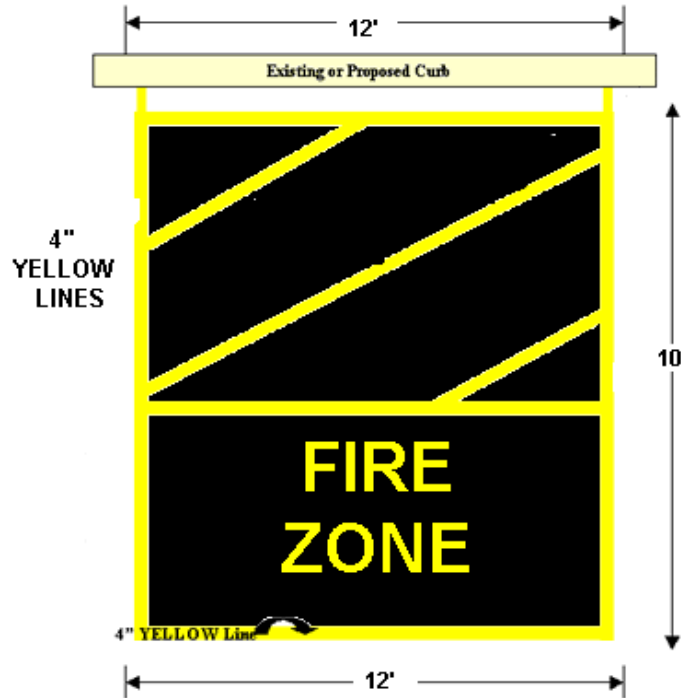

## "FIRE ZONE SIGNS"

Fire zone signs shall be erected with the bottom of the sign not less than six feet above the ground, (12") twelve inches wide by (18") eighteen inches in length with a white reflective aluminum background with a red border and a minimum of (3") three inch sized reflective red letters labeled "NO" on the first line, (3") three inch sized reflective red letters labeled "PARKING" on the second line, (2") two inch sized reflective red letters labeled "FIRE" on the third line and (2") two inch sized reflective red letters labeled "LANE" or "ZONE" on the fourth line. Spacing of the signs shall be even, with one sign facing the direction of travel or alternate direction of travel for a maximum distance 100' one hundred feet per sign or as ordered by the Fire Official.

